


- SEPARATION OF WATER MAINS AND SANITARY SEWERS:**
- A MINIMUM HORIZONTAL DISTANCE OF 10 FEET SHALL BE MAINTAINED BETWEEN WATER (MAINS AND SERVICE) AND SANITARY SEWER (MAINS AND SERVICE) LINES.
 - WHERE A WATER MAIN MUST CROSS A SEWER LINE, MAINTAIN 2 FEET VERTICAL SEPARATION WITH THE WATER MAIN ABOVE THE SEWER.
 - BUILDERS TO MAINTAIN MINIMUM 10' SEPARATION FROM THE OUTSIDE EDGE OF SANITARY SEWER MANHOLES TO THE OUTSIDE EDGE OF WATER SERVICE LINES WHEN RUNNING SERVICE LINES TO HOUSE.

SCALE:
 PLAN: 1"=20'
 PROFILE: 1"=20' HORIZ.
 1"=5' VERT.

- GENERAL NOTES:**
- ALL SANITARY SEWER SERVICE LINE WILL BE AT A MIN 2% GRADE.
 - ALL NORTHING AND EASTING WAS TAKEN FROM CENTER OF STRUCTURE. REFERENCE DETAIL FOR ACTUAL LID LOCATION.

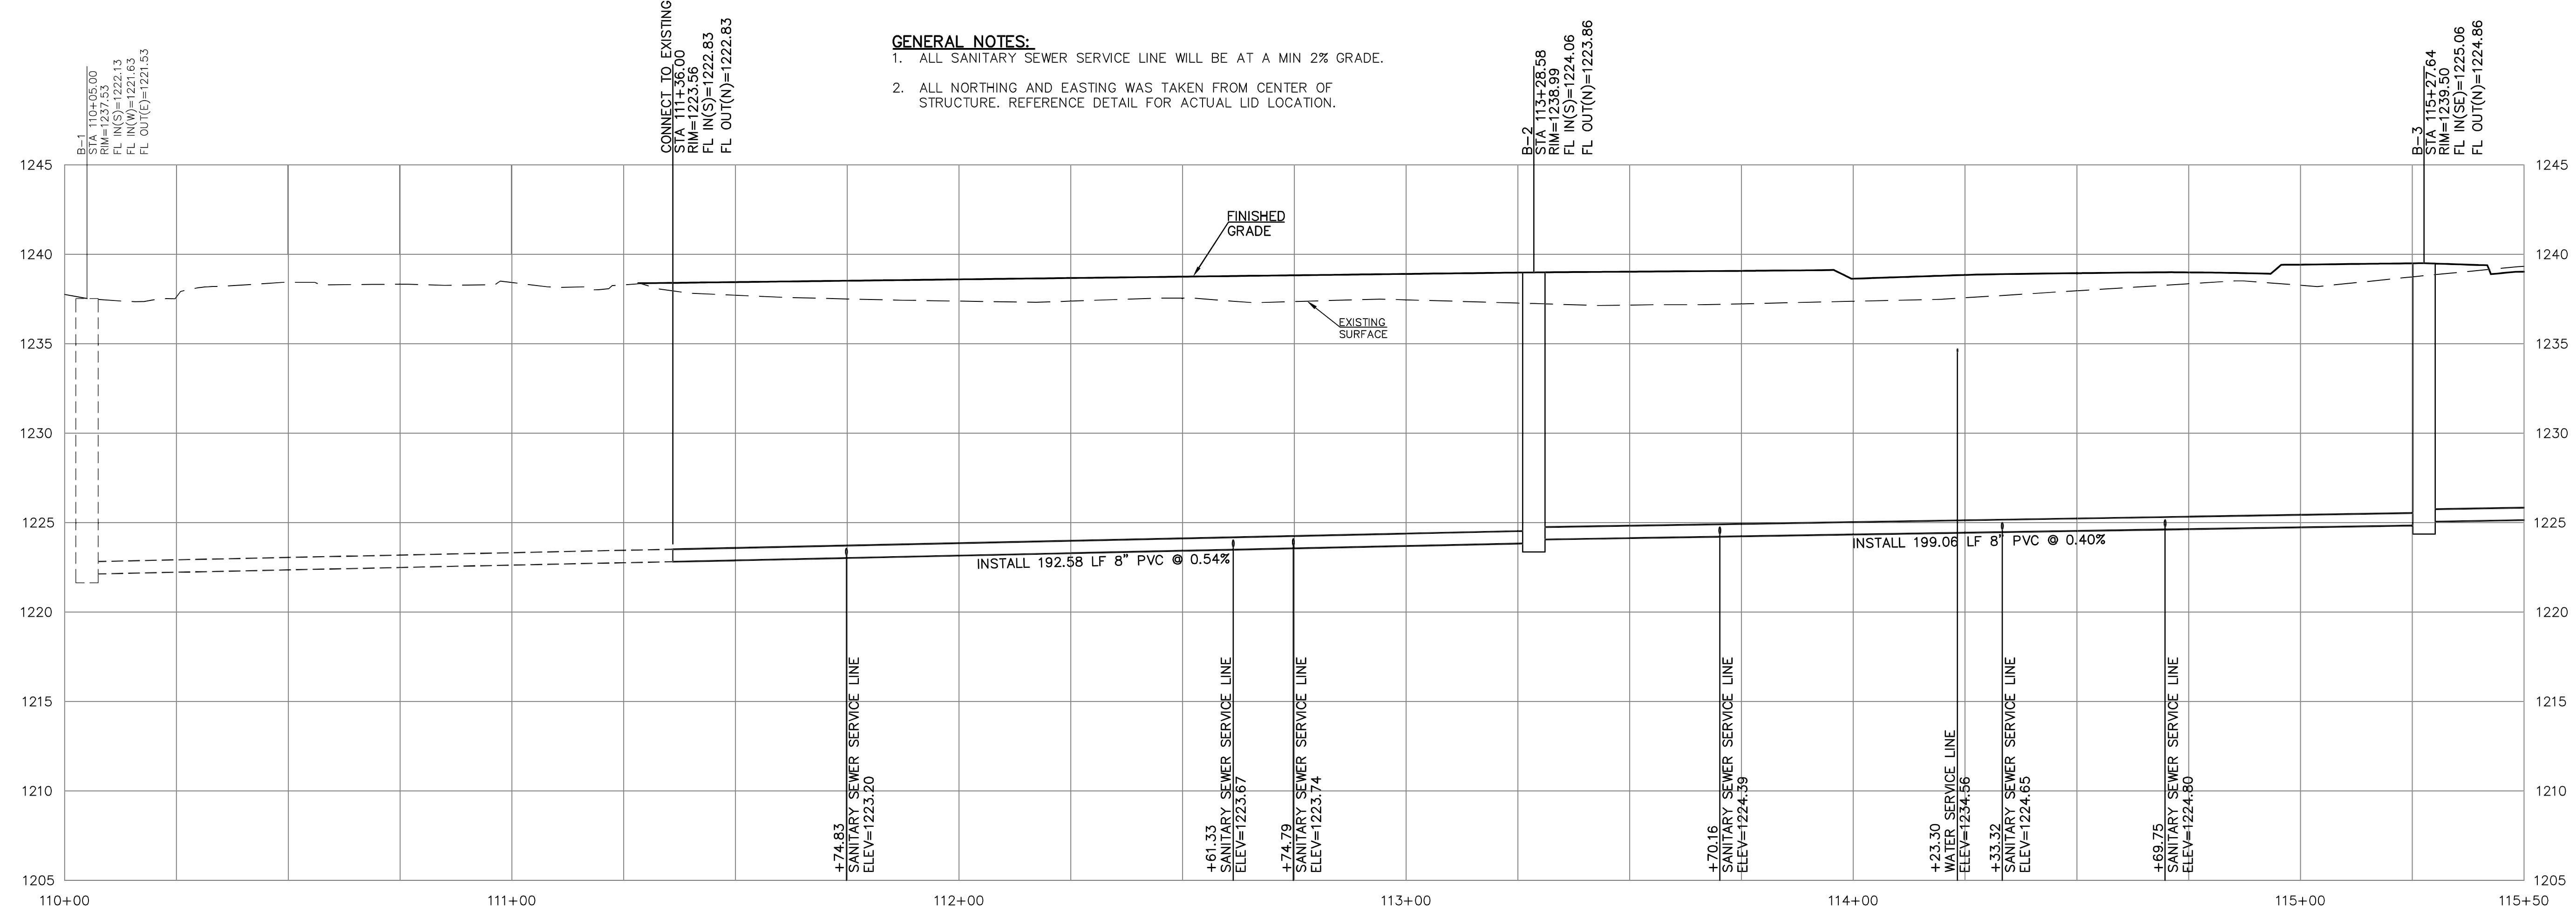

REV	DATE	DESCRIPTION
0	01/11/22	INITIAL ISSUE
JMO	TDA	DSN
JMO	DWN	CHK

JUSTIN M. OWENS
ENGINEER
KS # 20933

742 DUVALL AVENUE
SALINA, KANSAS 67401 823-3411
PH. (785) 823-3411
www.kawvalley.com

KAW VALLEY ENGINEERING
KAW VALLEY ENGINEERING, INC. IS AUTHORIZED TO OFFER ENGINEERING SERVICES BY KANSAS STATE CERTIFICATE OF AUTHORIZATION # E-113. EXPIRES 12/31/22

STONE LAKE ADDITION - PHASE 3C
CRYSTAL LAKE DRIVE & SHORELINE DRIVE
SALINA, KANSAS

OFFICE CHECK
SANITARY SEWER LINE 'B' - PLAN & PROFILE

PROJ. NO.	E21D2859
DESIGNER	JMO
DRAWN BY	TDA
CFN	2859SPP
SHEET	28
REV	0